


# First Flush

The Rainwater Tank Design and Installation Handbook published by Standards Australia advises, 'To improve rainwater quality a minimum 20 litres per 100 m<sup>2</sup> of the first flush of roof catchment shall be diverted/discarded before entering the rainwater tank'.

The SWT First Flush unit will divert 170L of the initial flow. It is suitable for 850m<sup>2</sup> of roof area.

While rain continues water will enter the water tank, when the rain stops the pit will slowly drain and be ready for the next rain event.

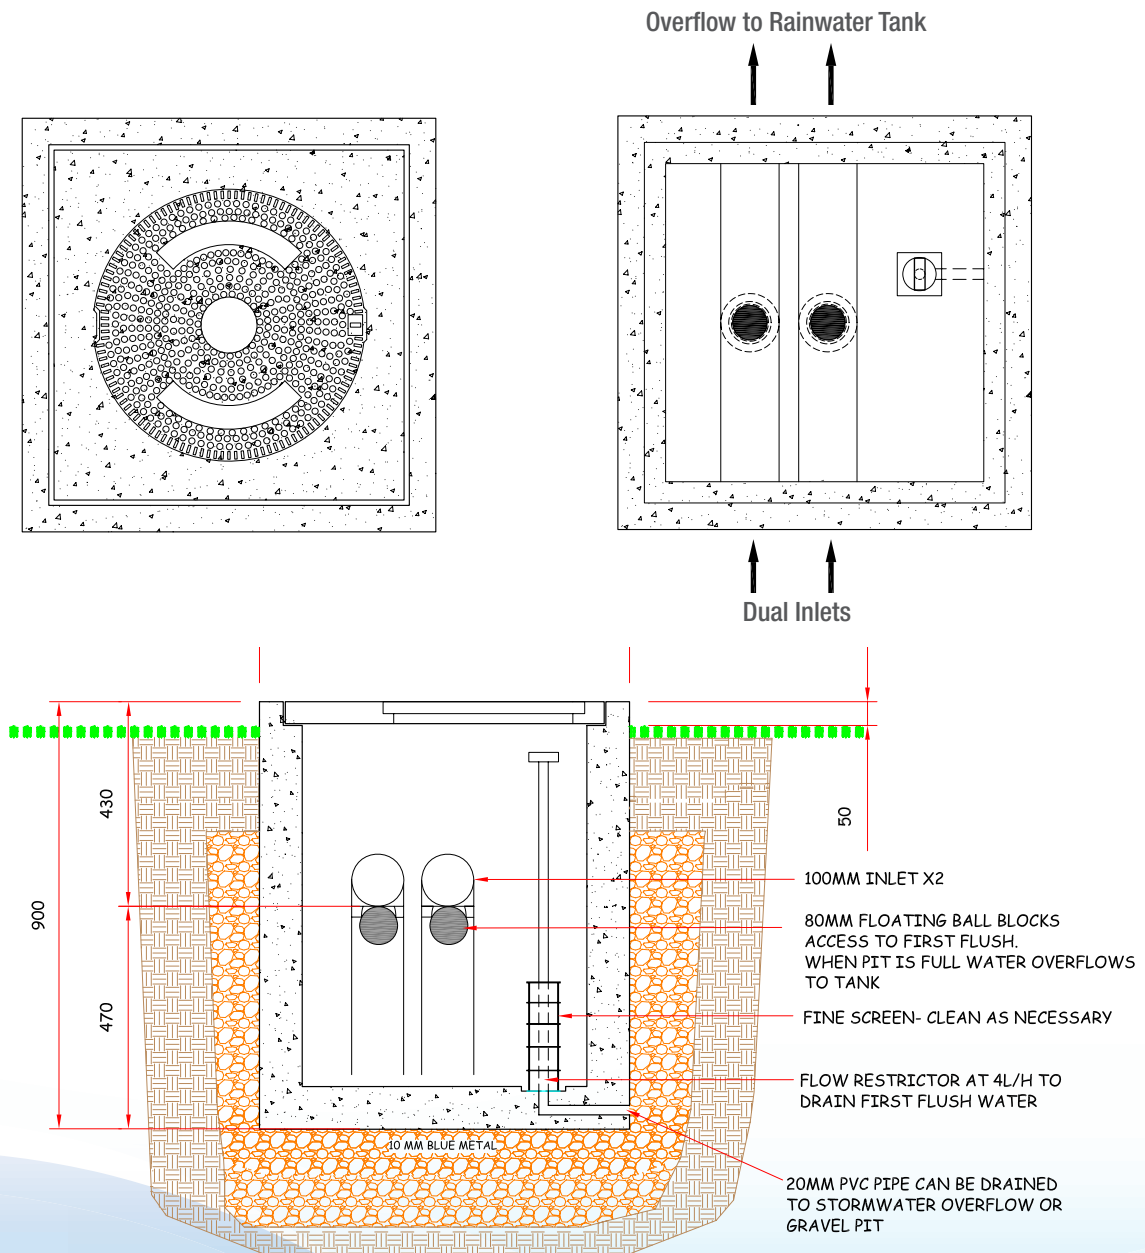

CAPACITY- 170 LITRE  
 SUITABLE FOR 850M<sup>2</sup> ROOF AREA AT 20L/100M<sup>2</sup>

1-5 Anzac Avenue, Smeaton Grange NSW 2567  
 P.O Box 3250, Narellan NSW 2567  
 Telephone: 02 4629 6688  
 Facsimile: 02 4629 6677  
 sales@sydneywatertanks.com.au

A division of BioSeptic Pty Ltd  
 ABN 95 056 461 226